


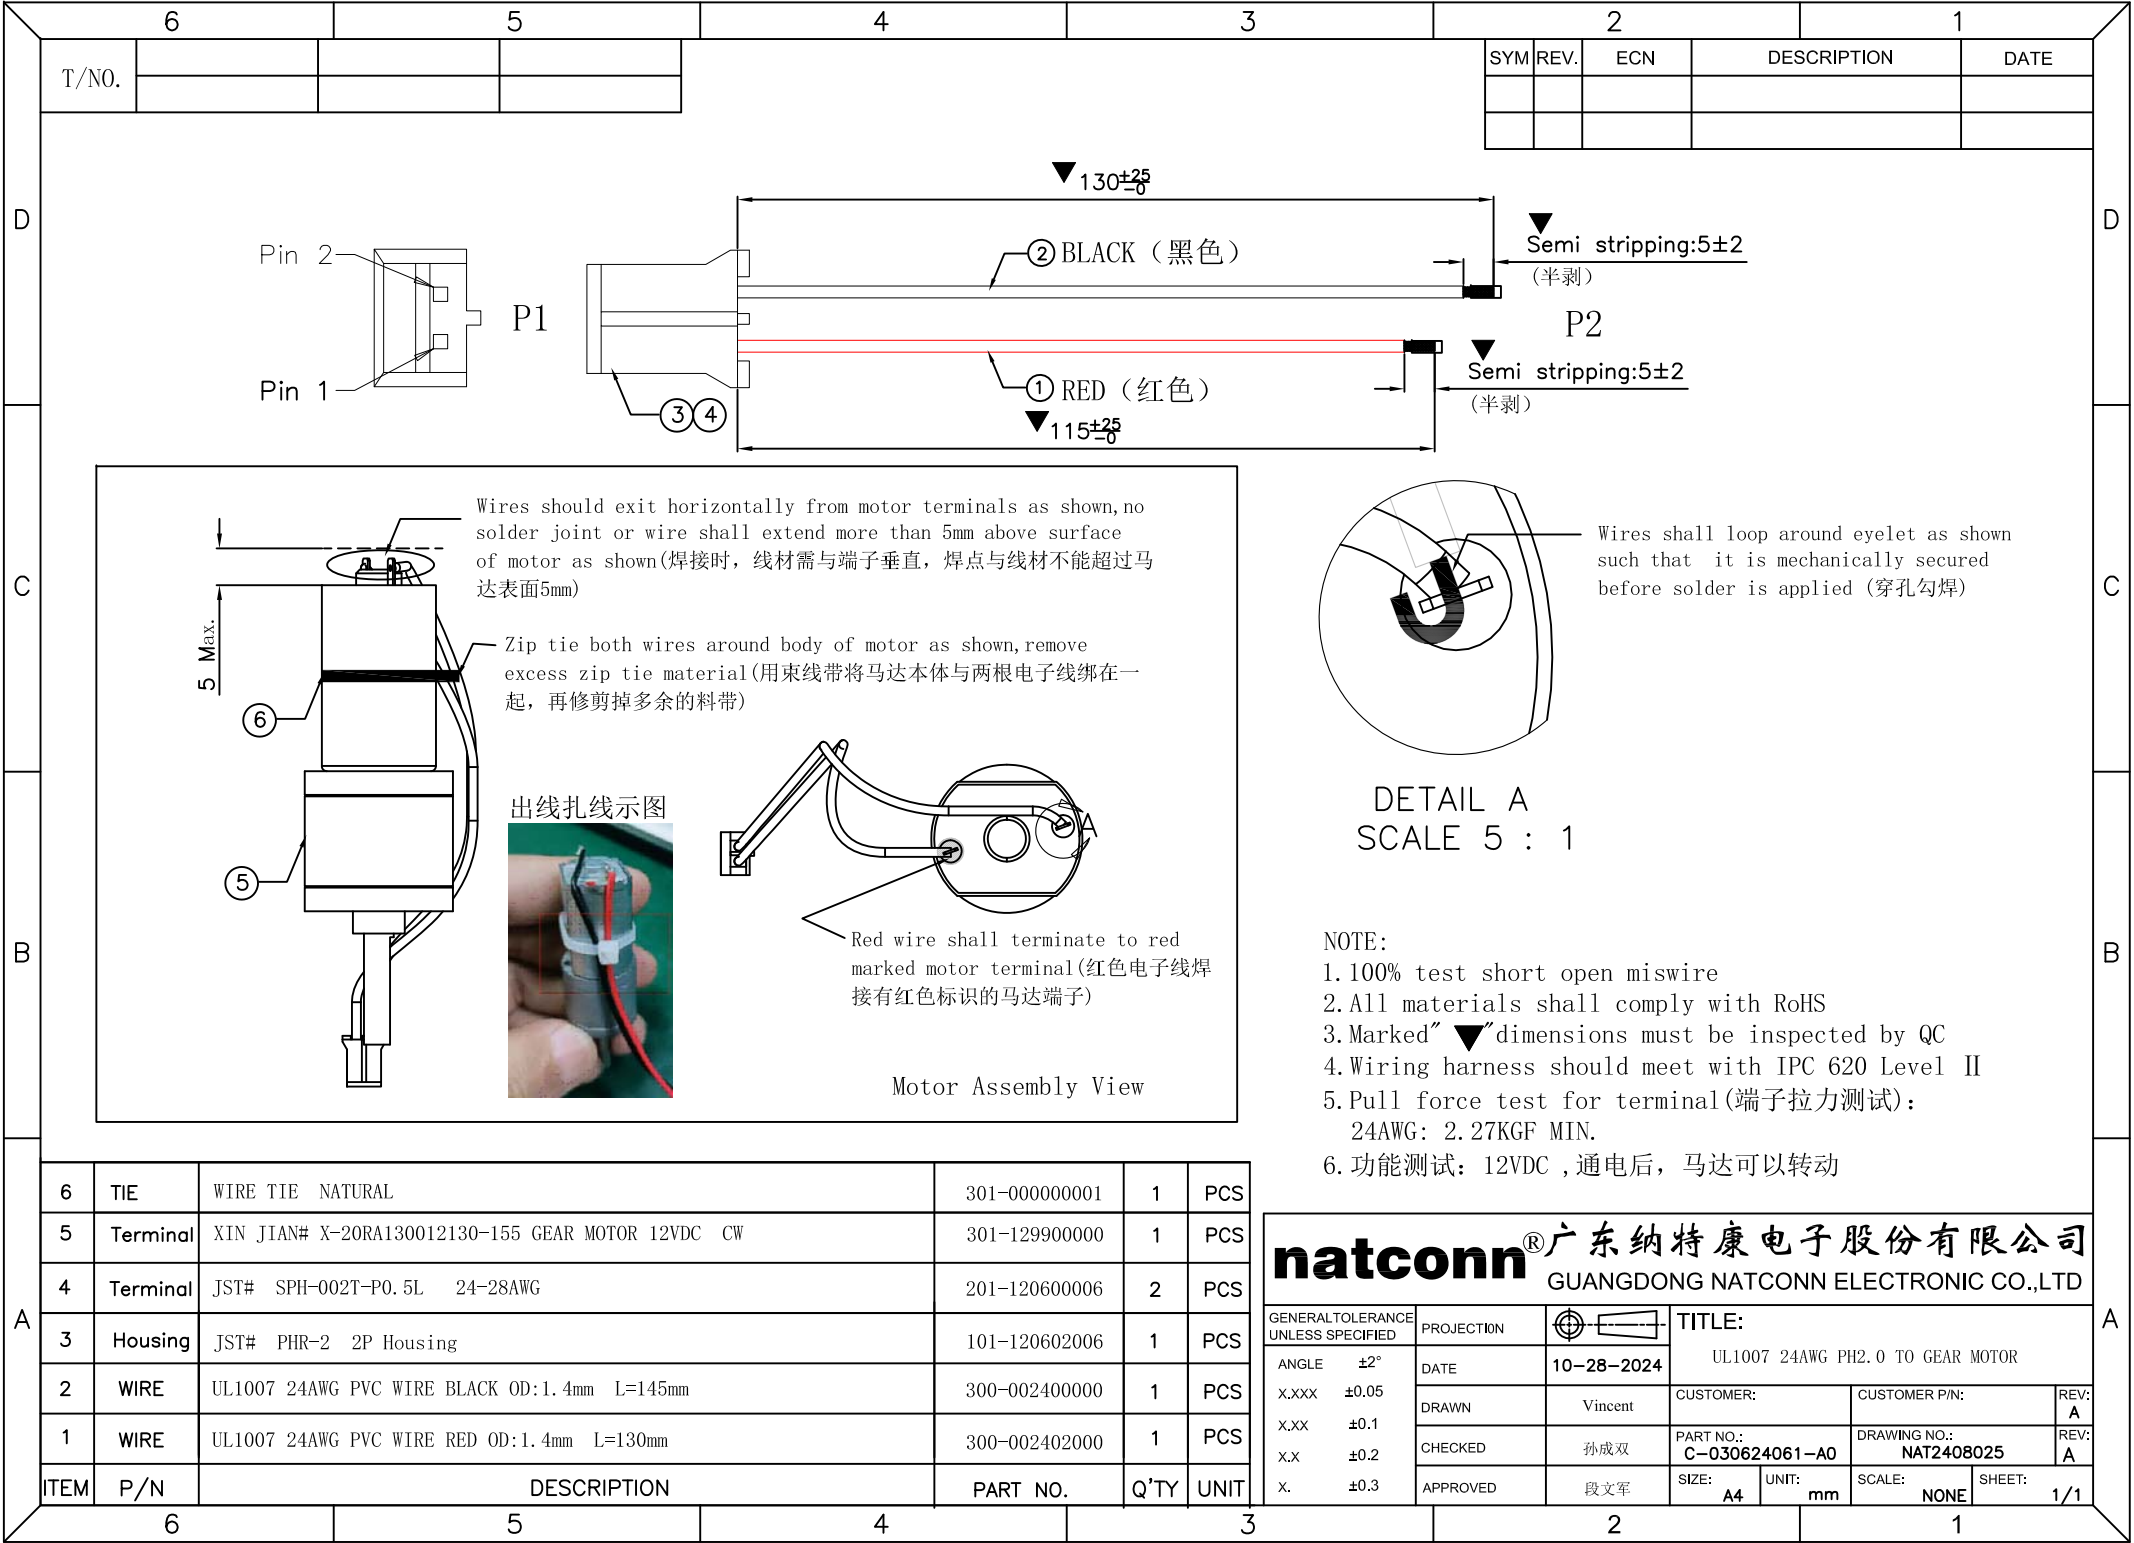

6	TIE	WIRE TIE NATURAL	301-000000001	1	PCS
5	Terminal	XIN JIAN# X-20RA130012130-155 GEAR MOTOR 12VDC CW	301-129900000	1	PCS
4	Terminal	JST# SPH-002T-P0.5L 24-28AWG	201-120600006	2	PCS
3	Housing	JST# PHR-2 2P Housing	101-120602006	1	PCS
2	WIRE	UL1007 24AWG PVC WIRE BLACK OD:1.4mm L=145mm	300-002400000	1	PCS
1	WIRE	UL1007 24AWG PVC WIRE RED OD:1.4mm L=130mm	300-002402000	1	PCS
ITEM	P/N	DESCRIPTION	PART NO.	Q'TY	UNIT

NOTE:

- 1.100% test short open miswire
- 2.All materials shall comply with RoHS
- 3.Marked" ▼"dimensions must be inspected by QC
- 4.Wiring harness should meet with IPC 620 Level II
- 5.Pull force test for terminal(端子拉力测试):
24AWG: 2.27KGF MIN.
- 6.功能测试: 12VDC ,通电后, 马达可以转动

natconn[®]广东纳特康电子股份有限公司

GUANGDONG NATCONN ELECTRONIC CO.,LTD

GENERAL TOLERANCE UNLESS SPECIFIED		PROJECTION	TITLE:		
ANGLE ±2°		DATE	10-28-2024		
X,XXX ±0.05		DRAWN	Vincent		
X,XX ±0.1		CHECKED	孙成双		
X,X ±0.2		APPROVED	段文军		
X. ±0.3					
SIZE: A4		UNIT: mm	SCALE: NONE		
SHEET: 1/1					

CUSTOMER:

CUSTOMER P/N:

REV: A

PART NO.: C-030624061-A0

DRAWING NO.: NAT2408025

REV: A